



INTUBATT 1

Test Performance

Warrington Fire Research.

21st May 1997

Report R13526

Warrington Fire Research.


2nd May 1995

Report R11848B

Warrington Fire Research.

3rd September 1996

Report R13175

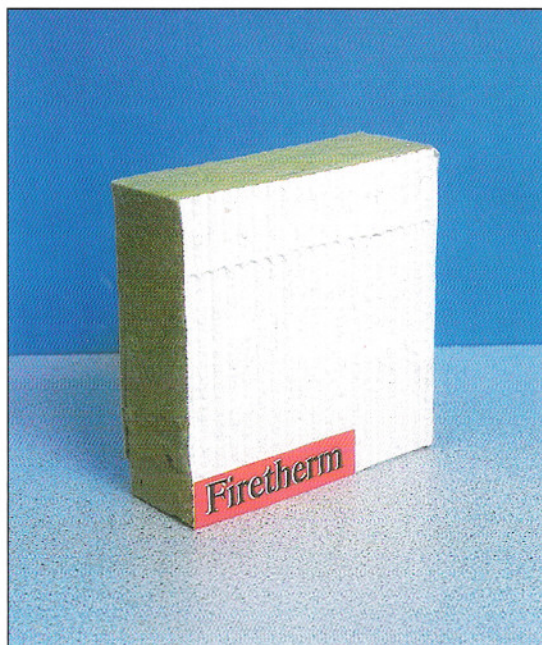

Firetherm Intubatts

Firetherm Intubatt 1 is used to seal around service penetrations through walls and floors where a non-load bearing seal is required. A single Intubatt 1 can provide up to 2 hours fire integrity and 120 minutes insulation in a wall and 117 minutes integrity and 62 minutes insulation in a floor.

4 hours integrity and insulation can be achieved with 2 Intubatt 1's.

To reflect the increasing concern amongst building owners and specifiers regarding fire **insulation** to services and the forthcoming European standard EN1366, Firetherm have recently undertaken a new fire test program to provide specifications for a wide range of services such as duct/dampers, steel/copper pipes and armoured power cables up to 70mm diameter.

Please contact the Firetherm Technical Department for further details on +44 (0) 1322 551010

Description

A high density mineral fibre batt coated with a durable fire resistant mastic, 1200 x 600 x 50mm. The mastic coating is white and can provide Class 1 spread of flame or Class 'O' fire propagation standard when overcoated with Firetherm's Flexcote 15.

Supplied packed singly in strong polythene bags.

Intubatt 1 can be cut with a serrated knife or padsaw.

The Intubatt 1 system requires no "buttering up" of the edges of the wall prior to installation of the batt nor the edges of each cut segment provided it is a tight fit. Refer to the Intubatt 1 Installation Instructions for further details. No coat-back to penetrating services is necessary for integrity only.

Specification Wording

"Install Firetherm Intubatt 1 to provide fire and smoke seals for (1, 1½, 2, 4 hours) fire protection fully in accordance with Firetherm's Installation Instructions.


Firetherm, Crayford, England. Tel: +44 (0) 1322 551010; Fax: +44 (0) 1322 552727".



Firetherm supports BSI Accredited Installers



Formerly ASFPCM



Above Logo's Are
Company Approvals
only. Please Check
For Individual
Product Approvals.

Firetherm, Unit F, Acorn Industrial Park, Crayford Road, Crayford, Kent. DA1 4FT England
Tel: +44 (0)1322 551010 Fax: +44 (0)1322 552727 www.firetherm.com

March 2008. In presenting this technical leaflet we cannot claim to serve in any but an advisory capacity and can undertake no liability since actual conditions of use are beyond our control.
Our Standard Terms & Conditions Apply At All Times